

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Name and address of the applicant

Name and address of the manufacturer

Name and address of the factory

Note: When more than one factory, please report on page 2

Ratings and principal characteristics

Trademark / Brand (if any)

Customer's Testing Facility (CTF) Stage used

Model / Type Ref.

Additional information (if necessary may also be reported on page 2)

A sample of the product was tested and found to be in conformity with

As shown in the Test Report Ref. No. which forms part of this Certificate

Switch-disconnector

SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

SOCOMEC S.A.S

1, Rue De Westhouse 67230 Benfeld Cedex France

See the Appendix

SOCOMEC

N/A

SIRCO MOT DC, SIRCO MOT DC ESS;

IEC 60947-1:2020;IEC 60947-3:2020

00901-CB2022CQC-101616

This CB Test Certificate is issued by the National Certification Body

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China Tel: +86-10-83886666 Fax: +86-10-83886282

website: http://www.cqc.com.cn

Sep.14,2022






Date:







Ui:1500V;Uimp:12kV;

Ith:2500A,3200A,3600A(Single circuit);1600A(3200A for double circuit);

Ue:DC1500V;

le:2500A,3200A,3600A(Single circuit);1600A(3200A for double circuit);

Utilization category:DC-21B;

Icw:45kA/1s(2500A,3200A,3600A);20kA/1s(double circuit 1600A);

Icm:45kA(2500A,3200A,3600A);20kA(double circuit 1600A);

DC diagram:

2500A,3200A,3600A:1 circuit with 2 Poles in series:




Diagram 1




Diagram 2

Page 1 of 2

Additional information (if necessary)

Date:


Sep.14,2022

Signature: 谢肇顺

Tel: +86-10-83886666

Fax: +86-10-83886282

CN57799

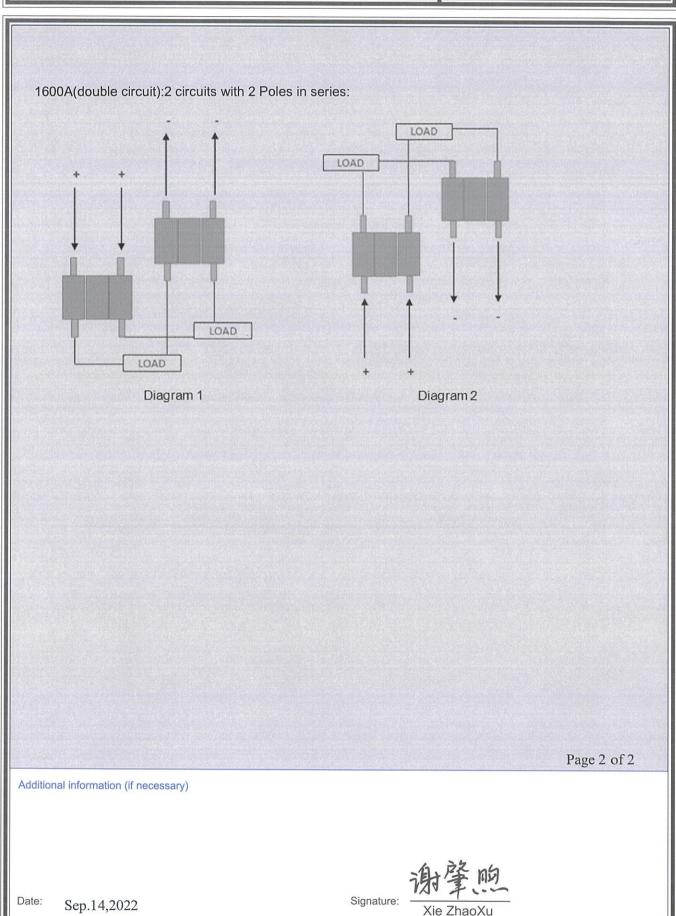

Tel: +86-10-83886666 Fax: +86-10-83886282